


FIRE COMPANY CERTIFICATION:	
NAME & TITLE	YES ____ NO ____
NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION	
NAME & TITLE	YES ____ NO ____
FREEZE PROTECTION	
14" PVC FROM HEAD ASSY TO BELOW NORMAL WATER ANNUAL SPACE FILLED WITH INSULATION FOAM. (PREFOLDED OR EXPANDING FOAM)	YES ____ NO ____
GUARDED POSTS - SEE NOTE #1	
YES ____ NO ____	

BILL OF MATERIALS		MARK	QUAN.	UNIT
ITEM				
6" HYDRANT ASSEMBLY - 45' ELBOW		1	1	EACH
HYDRANT CAP		2	1	EACH
6" 3" PVC STRAINER		3	1	EACH
6" SCH. 40 PVC 45' ELBOW		4	1	EACH
6" SCH. 40 PVC PIPE-RISER		5	—	LN. FT.
6" SCH. 40 PVC PIPE		6	—	LN. FT.
6" SCH. 40 PVC COUPLINGS		7	—	EACH
UNDER-WATER SUPPORT		8	1	CAN
PVC GLUE		9	—	CAN
PRIMER CLENER				CAN
6" STRAINER CAP			1	EACH
ITEM	SITE DATA			
POOL			—	ADRES
DROUGHT POOL			—	ADRES
MINIMUM DRAW			—	FEET
MAXIMUM DRAW			—	FEET
AVAILABLE WATER AT NORMAL LEVEL			—	GAL.
AVAILABLE WATER AT DROUGHT LEVEL			—	GAL.

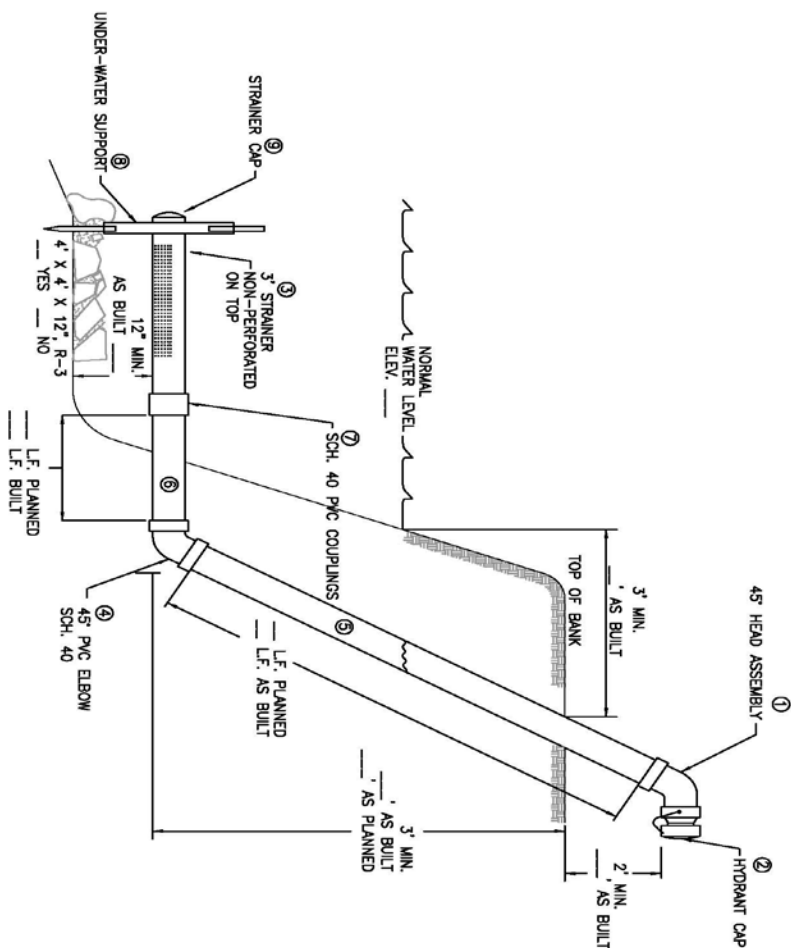

PROFILE
NOT TO SCALE

NOTES:
1. FOR GUARD POSTS, IF REQUIRED, SHALL BE
2. UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR
CONSTRUCTED FOR LOCAL CONDITIONS.

Designated _____	Date _____
Drawn _____	_____
Observed _____	_____
Approved by _____	_____

COUNTY, PENNSYLVANIA

6" DRY HYDRANT - SLOPING

File no.
PA-0528.D.docx

Yes

PA-0528